


NOTE: DIRECTION/ORIENTATION OF BLIND FLANGE FACE TO BE DETERMINED BY SITE LAY OUT AND APPROVED BY TOWN WASTEWATER DEPT. PRIOR TO INSTALLATION.

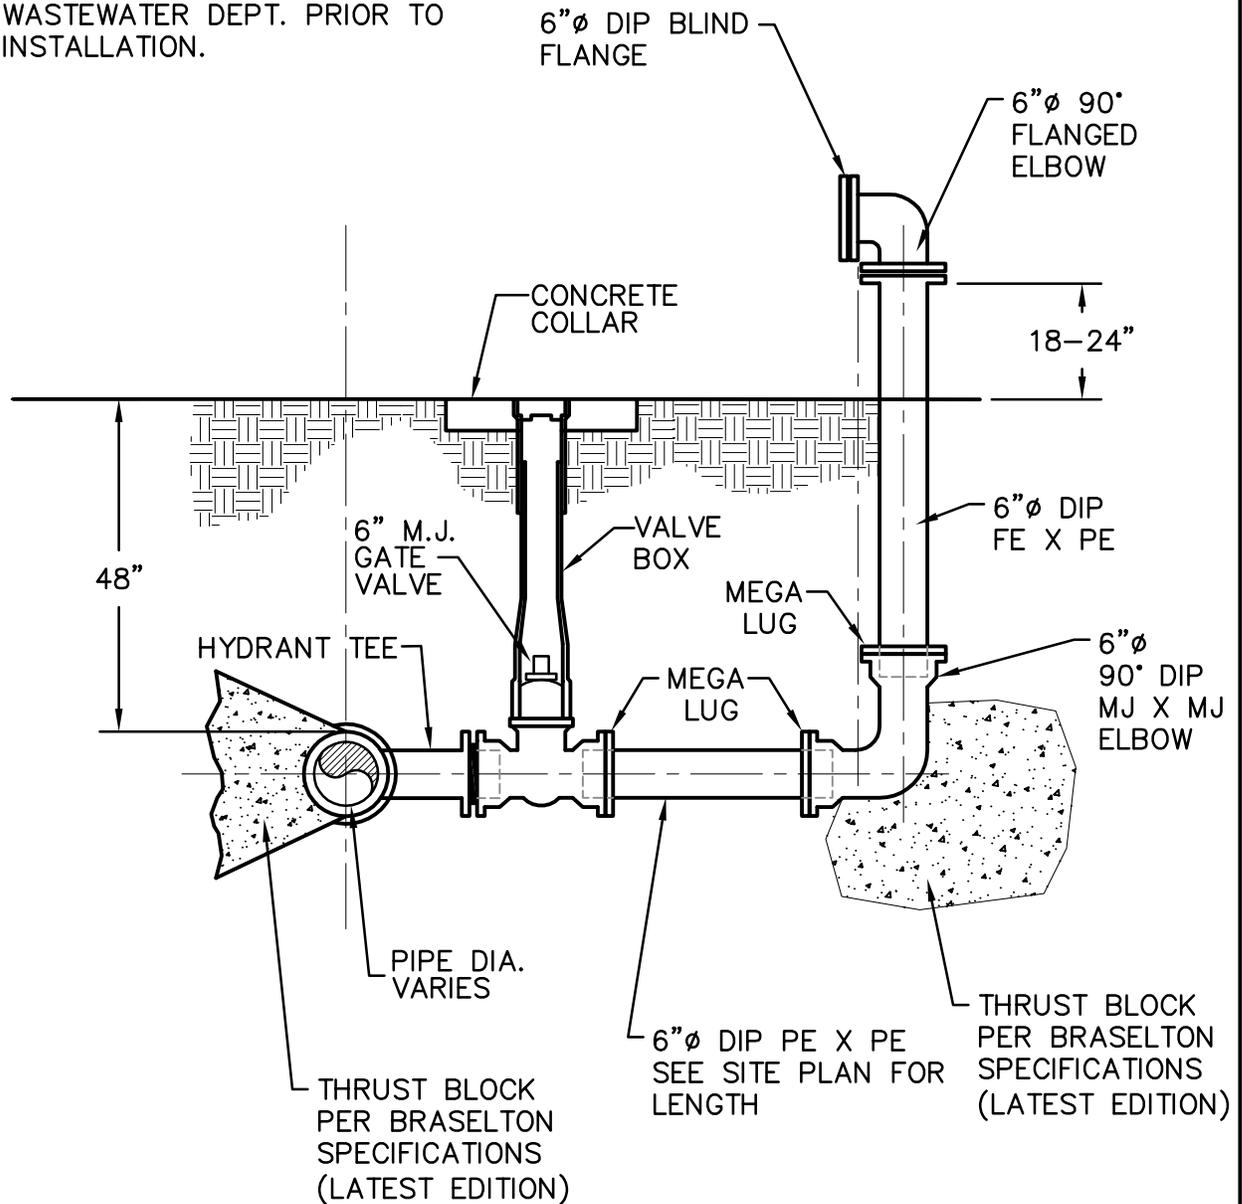

NOTE: CONTRACTOR TO VERIFY THAT FLANGE IS COMPATIBLE WITH TOWN'S PORTABLE PUMP STATION DISCHARGE PIPING

**TOWN OF BRASELTON WATER & SEWER DEPARTMENTS**

JOB TITLE	SHEET TITLE	DRN. BY: EMI	REV. NO.	BY	DATE
		CKD BY:			
STANDARD DETAIL	<b>BYPASS CONNECTION</b>	APPD. BY:			
		DATE: JANUARY 2006			
	DETAIL No. PS-11	FILE No. 03033/PS-11.dwg	SCALE: N.T.S.		