
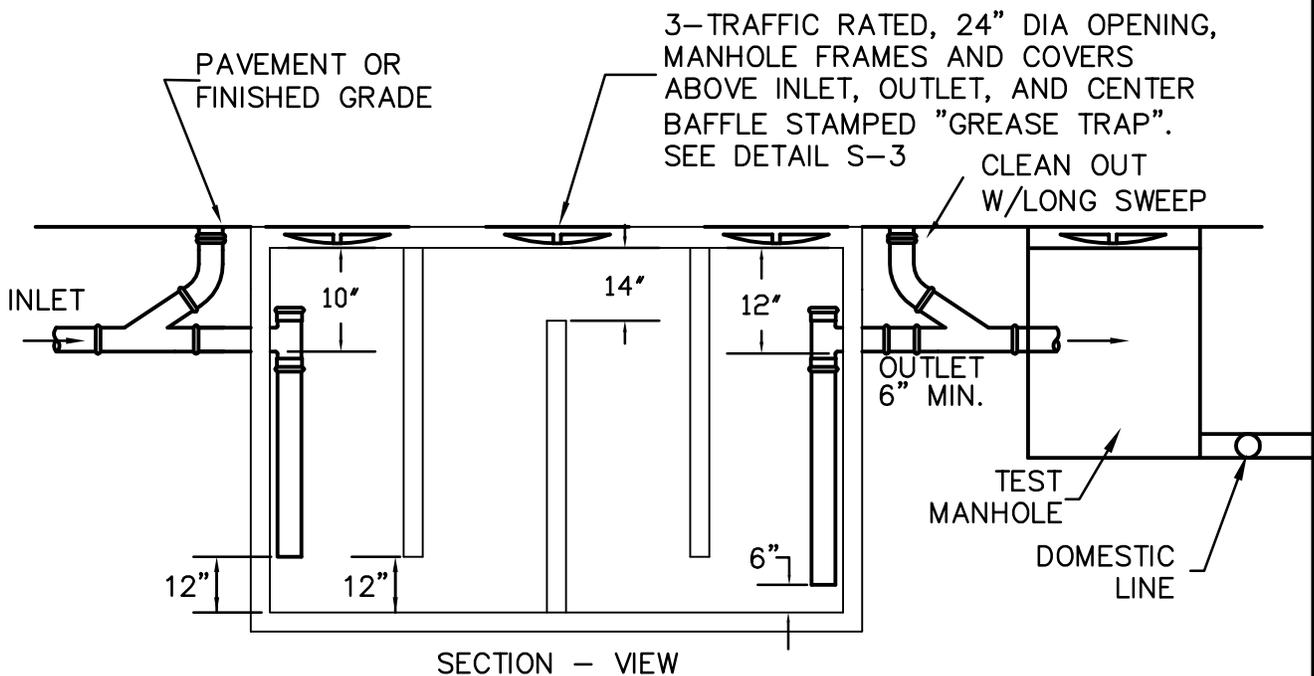


NOTE: TYPICAL SIZE FOR 1,500 GALLON GREASE TRAP IS 10'L X 5'W X 5'D.

3 ea. BAFFLE WALLS - TYP.

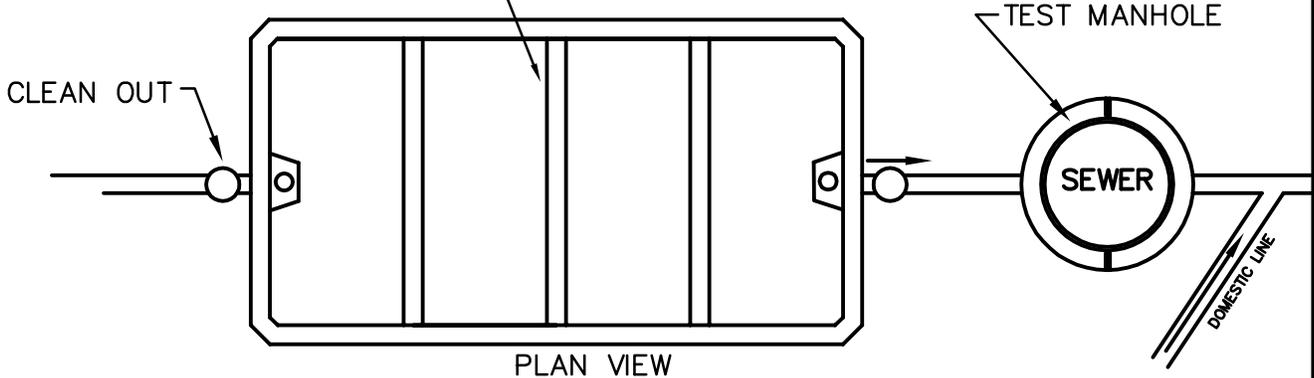

NOTES:

1. MINIMUM CAPACITY OF 1500 GALLONS FOR ALL GREASE TRAPS.
2. DEVELOPER MUST SUBMIT GREASE TRAP DESIGN PRIOR TO DEVELOPMENT PERMIT ISSUANCE. SEE DETAIL S-25 FOR MINIMUM DESIGN CAPACITIES.
3. DEVELOPER MUST DESIGN ANY GREASE TRAP IN ACCORDANCE WITH DEPARTMENT OF HUMAN RESOURCES PUBLIC HEALTH, CHAPTER 290-5-26, SECTION D, GREASE TRAPS. DEVELOPER TO SUBMIT CALCULATIONS WITH DESIGN DRAWINGS PRIOR TO PERMITTING.

TOWN OF BRASELTON WATER & SEWER DEPARTMENTS

JOB TITLE STANDARD DETAIL	SHEET TITLE GREASE TRAP DETAIL	DRN. BY: EMI	REV. NO.	BY	DATE
		CKD BY:	A	EMI	3/13/07
		APPD. BY:			
		DATE: MAY 2006			
		DETAIL No. S-24	FILE No. 03033\S-24.dwg	SCALE: N.T.S.	