


PLAN VIEW OF MANHOLE

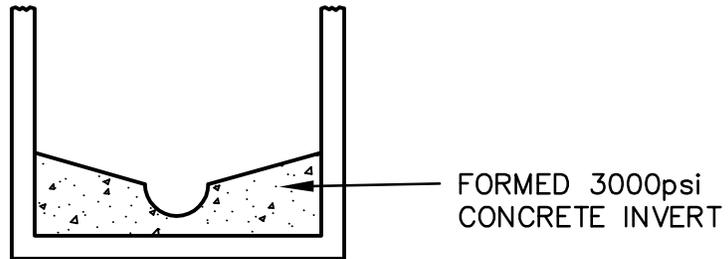

SOLID INVERT

- NOTE: 1. PRECAST INVERTS ARE ACCEPTABLE.
 2. A 0.2 FOOT DROP ACROSS INVERT REQUIRED.

NOTE:
 DEVELOPER/CONTRACTOR IS REQUIRED TO PERFORM VACUUM TESTS
 IN ACCORDANCE WITH SECTION 02601-MANHOLES, OF THE TOWN OF BRASELTON
 STANDARD SPECIFICATIONS (LATEST EDITION)

TOWN OF BRASELTON WATER & SEWER DEPARTMENTS

JOB TITLE STANDARD DETAIL	SHEET TITLE INVERT CONSTRUCTION	DRN. BY: EMI	REV. NO.	BY	DATE
		CKD BY:			
		APPD. BY:			
		DATE: SEP. 2004			
		DETAIL No. S-8	FILE No. 03033\S-8.dwg	SCALE: N.T.S.	