


METER BOX TO BE  
MODEL # LB75, FLIP-TOP  
ENCLOSURE BY HOT BOX  
OR APPROVED EQUAL

REDUCED PRESSURE  
BACKFLOW PREVENTER;  
MODEL 375 BY WILKINS

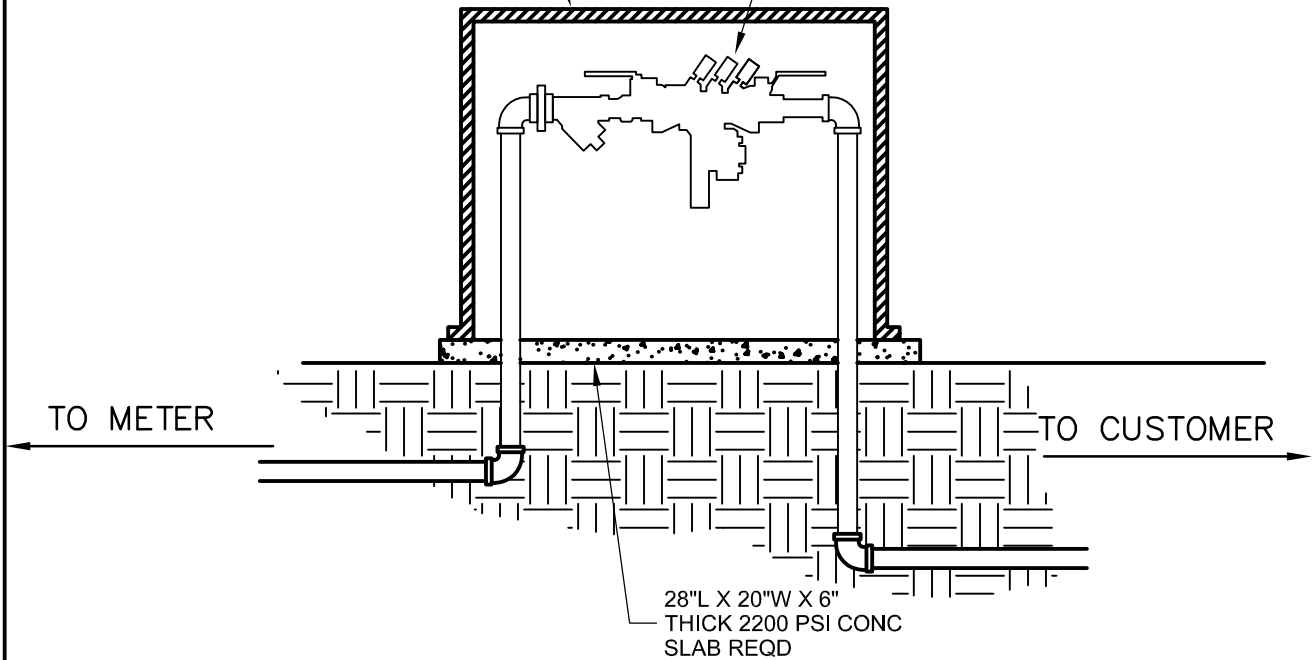

NOTES:

1. THE BACKFLOW PREVENTER ASSEMBLY SHALL BE OF THE REDUCED PRESSURE ZONE TYPE.
2. SHUT-OFF VALVE W/DRAIN TO BE INSTALLED IN METER BOX, W/ 2 C.F. CRUSHED STONE UNDERNEATH
3. ALL PIPES AND FITTINGS 2" THROUGH 4" SHALL BE BRASS.  
ALL PIPE AND FITTINGS LARGER THAN 4" SHALL BE D.I.P. CL 350 MIN.

**TOWN OF BRASELTON WATER & SEWER DEPARTMENTS**

JOB TITLE  STANDARD DETAIL	SHEET TITLE  <b>RPZ BACKFLOW PREVENTER</b>	DRN. BY: EMI	REV. NO.	BY	DATE
		CKD BY:			
		APPD. BY:			
		DATE: SEP. 2004			
		DETAIL No. W-19	FILE No. 03033\W-19.dwg	SCALE: N.T.S.	